


**WATER PENETRATION RESISTANCE PERFORMANCE TEST IN
ACCORDANCE WITH ASTM-E331/ASTM-E547 TEST PROCEDURES**

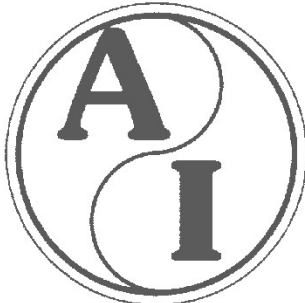


Report No.:
AI-04197-B1

Product Manufacturer:

**FERCO ARCHITECTURAL HARDWARE INC.
2000, BERLIER STREET
LAVAL, QUEBEC
H7L 4S4
450-973-1437**

Test Report Summary:

Product type:	Inswing Opaque Steel Door with Sidelite	
Evaluated product	Set of handle with sealed Gasket	
Test results:	No water penetration until a difference of pressure of 730 Pa (15 psf) in accordance with ASTM E331/ASTM E547 test procedures.	
Test completion date:	02/11/2014	
Report date:	05/02/2015	
Revision date:	--	
Number of pages:	4 and 1 Appendix	
Note:	Reference must be made to Air-Ins Inc. complete report for test specimen description and detailed test results.	

Prepared by :




Digitally Signed by:

Jean Miller, Eng.

Vice President & General Manager
Air-Ins Inc.

Approved by :



Digitally Signed by:

Robert Jutras, Eng.

President
Air-Ins Inc.



AIR-INS inc.

1320, boul. Lionel-Boulet,
Varenes (Québec) J3X 1P7

☎ (450) 652-0838

📠 (450) 652-7588

📧 info@air-ins.com